

ADDENDUM NO. 3
Contract 7-2013
April 23, 2015

CONTRACT AND SPECIFICATIONS
SUNSHINE ESTATES SANITARY SEWER
IMPROVEMENTS PROJECT

CONTRACT 7-2013
MORGANTOWN UTILITY BOARD
MORGANTOWN, WV

This Addendum to the Contract and Specifications is issued to modify, explain, or correct the original Contract and Specifications and is hereby made part of the Contract Documents. Insert the date and number of this Addendum in the blank space provided in Bid Envelope 1, Page B-29, and Bid Envelope No. 2, Page B-35.

SPECIFICATIONS

1. Appendix A – Standard Detail Drawings

Replace existing SPEC 20 – Air Release Valve Detail with the attached revised detail. One-inch pipe replaced with 2-inch pipe.


BIDDERS MUST ACKNOWLEDGE RECEIPT OF THIS ADDENDUM IN THE SPACES PROVIDED IN THE BID FORM.

Dated at Morgantown, WV
April 23, 2015

Morgantown Utility Board
P.O. Box 852
Morgantown, WV 26507-0852

By: James W. Fetty Jr.
James W. Fetty Jr., PE



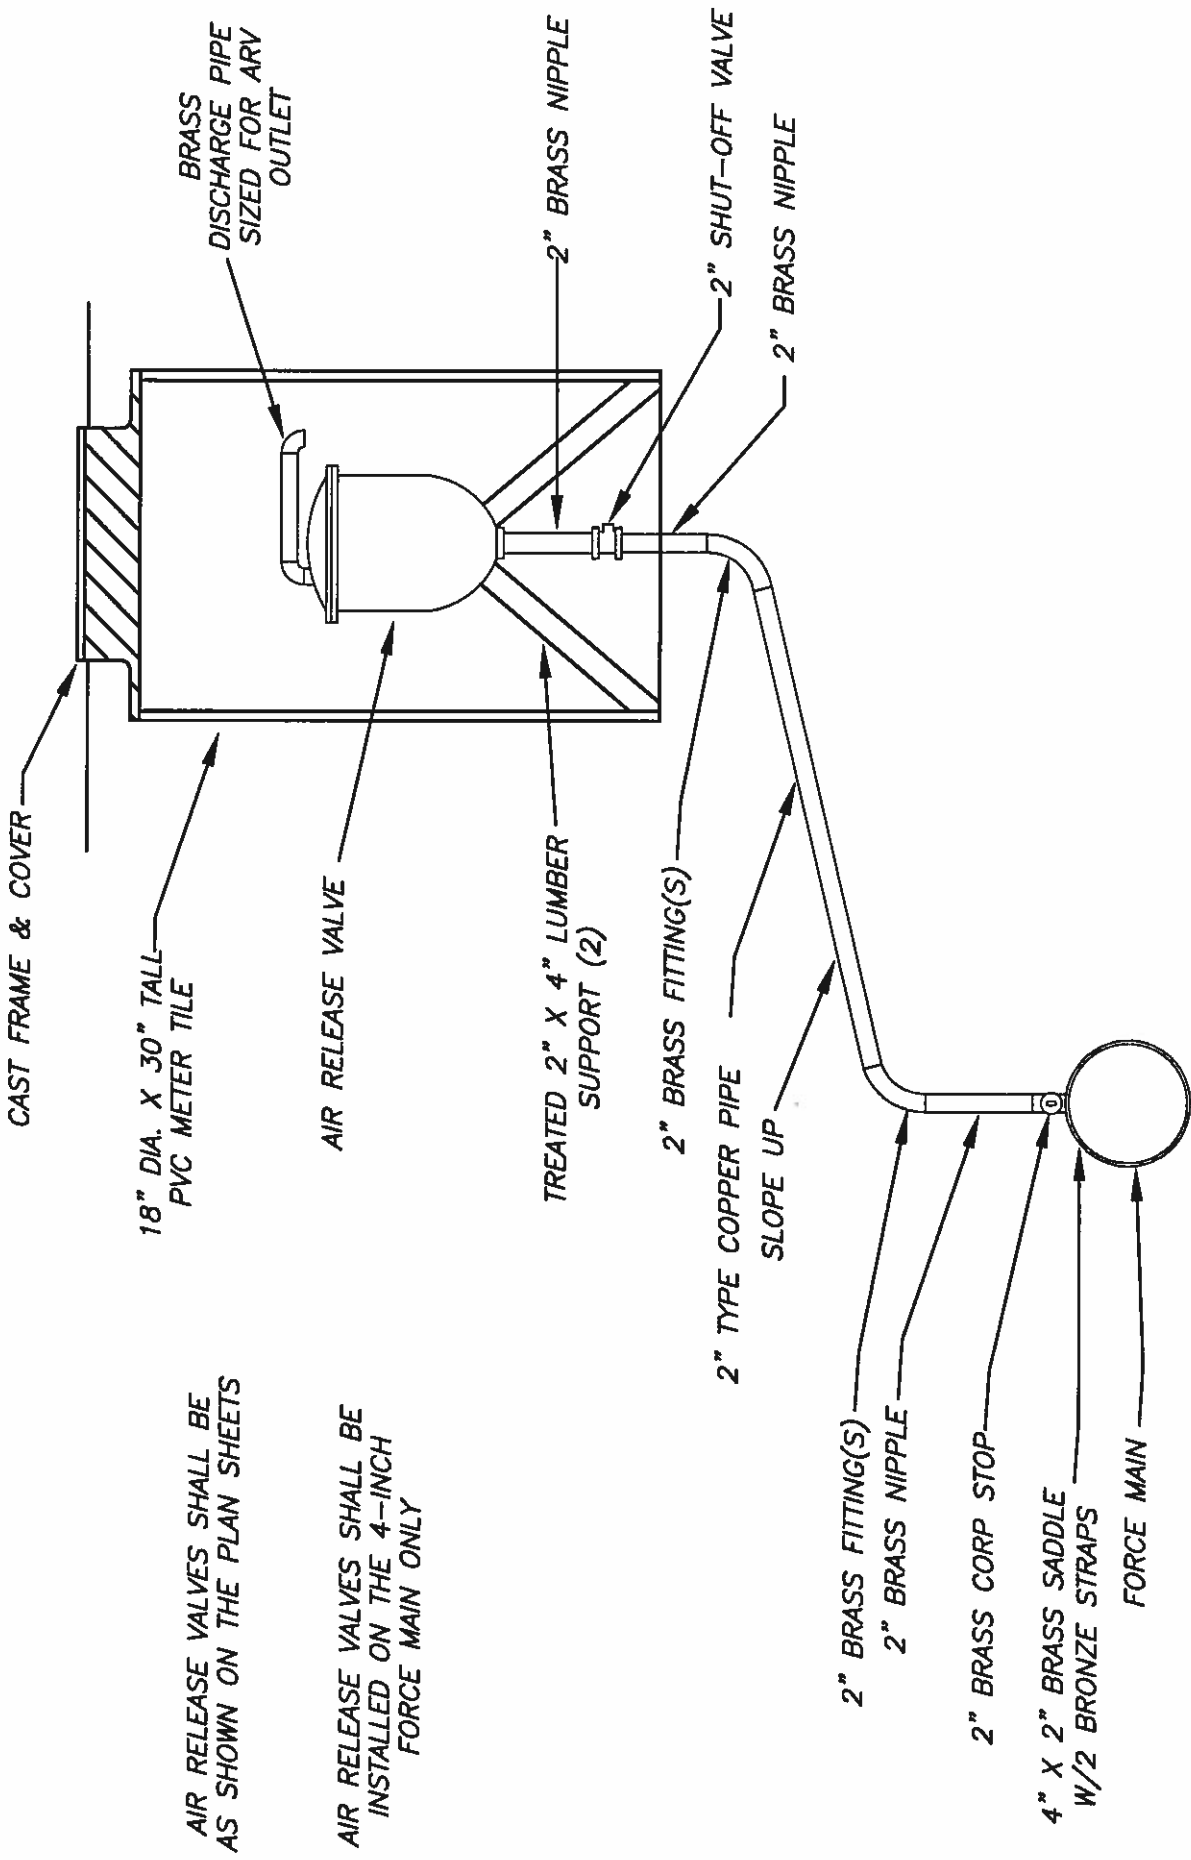

AIR RELEASE VALVES SHALL BE AS SHOWN ON THE PLAN SHEETS

AIR RELEASE VALVES SHALL BE INSTALLED ON THE 4-INCH FORCE MAIN ONLY

DRAWING TITLE: DETAIL AIR RELEASE VALVE		PROJECT NUMBER: -----	DRAWING NUMBER: SPEC. 020
SHEET: 1 of 1			
 MORGANTOWN • UTILITY • BOARD 278 Bowling Road • Post Office Box 853 • Morgantown, WV 26507-0853 • 304-282-9141			
DRAWN BY: David L. Bragg	DATE: 01-03-02	REVISION: 1. 2" PIPE 04/22/15	DATE: 04/22/15
CHECKED BY:	DATE:	APPROVED BY:	DATE:
SCALE: NOT TO SCALE			